

Our Ref: 19/2020-
Date:

Messrs:

Dear Sir,

TENDER 19/2020 **Outdoor Distribution Metal Pillars**

You are kindly requested to quote for the supply and delivery to our stores in Shufat (DDP) the following materials according to the following specifications:

Item (1):400 Pcs, low voltage (230/400V) Outdoor distribution small metal pillar with base, as shown in figure (1), dimensions 960*467*290 mm.

Item (2):100 Pcs, low voltage (230/400V) Outdoor distribution medium metal pillar with base, as shown in figure (2), dimensions 2063*806*390 mm.

Should the bidder consider that they can offer any advantages to our company by a modification to the specification, they can draw attention to such modification by an attached document stating that change.

Pillar Specifications:

The self-supporting pillar shall be manufactured from iron base super alloy ST.37 with thickness of no less than 3mm. The cabinets shall be designed for outdoor mounting for electrical instruments in main streets and cities. Fixing holes in the bottom shall be provided complete nuts, washers to fix the pillar with a standard base. Base legs shall be no less than (L: 360mm, WW: 40x40mm, Thickness: 3mm). **Pillar top shall be Kiosk designed.**

The pillars should be painted with thermal painting (EPOXY) of (70-80) Micron.

The pillars shall be arranged for front access only by means of side metal-hinged doors that have appropriate mechanical strength to hold the door/s and shall also be fitted with a locking bar to secure the pillar from top and bottom. The locking bar shall be operated by a central insulated metallic handle that shall be lockable by means of a padlock having a 13 mm hole as per the attached drawings.

The outdoor cabinets shall at least be IP 55 according to I.E.C-60529 or later amendments ensuring watertight sealing and impact resistance.

The outdoor cabinets shall protect the interior against all environmental hazards, for example and not limited to:

1. Rain
2. Corrosive materials
3. Fire retardant construction meeting VDE 0304 and UL-94-VO requirements
4. Resistance to extreme temperatures

The cabinet should be delivered empty (without busbars) and in light grey color (RAL7035), as per the drawings attached.

One sample of each type should be provided for inspection before manufacturing the whole quantity for approval.

Bidders are invited to view a sample of each type of the pillars in JDECO Shufat offices.

Essential Bidding Requirements:

- A bank certified check or a bank guarantee of 5% of the total tender valid for 90 days, to be submitted as a bid bond, otherwise, quotation will be neglected.
 - Quotation should be enclosed in a sealed envelope or package and handed over to the "Tender Committee" by the representative of the bidder or their agent not later than 5.11.2020 at 11:00 AM.
 - TENDER DOCUMENTS FEES: 500 US\$. A proof of payment should be sent by email to : rnashashibi@jdeco.net.
 - The main offer envelope or package should include three separate envelopes as follow :
 - a. The financial offer in a separate sealed envelope.
 - b. The technical offer & catalogues placed in a separate sealed envelope.
 - c. Your bid bond in a separate envelope.
 - Technical offer will be studied separately from the financial offer. The financial offers for bidders whose technical offers do not meet JDECO's technical requirements will not be opened.
 - In case offers are submitted by an agent on behalf of a certain supplier, a copy of the agreement between the agent and the supplier must also be submitted. Such copy has to be authenticated and certified by the chamber of commerce at the supplier's country of origin.
 - Offers have to be attached with a letter confirming the authorized persons signing on behalf of the bidder.
- Any bid package not according to the above will not be considered.**

Payment method in case of offer acceptance:

- 90 days after delivery of goods through bank transfers.
- The currency of the suppliers' invoices must be the same as the currency of their submitted offer and as specified in the letter of award, otherwise they will not be accepted.

Notes:

- The company has the liberty not to accept any or the lowest tender neither to assign any reason for rejection of any tender.
- The accepted bidder will be charged the expenses of the tender's advertisement in the local newspapers.
- Upon acceptance of offer the bidder will be requested to submit a Performance Bond equivalent to 10% of the tender total value, and should be valid for ...30..... working days from the date of executing all terms of contract.

List of Quantities:

Item No.	Description	Quantity	Unit	Unit Price	Total Price
1	Low voltage (230/400V) Outdoor distribution small metal pillar with base, as shown in figure (1), dimensions 960*467*290 mm.	400	Pcs.		
2	Low voltage (230/400V) Outdoor distribution medium metal pillar with base, as shown in figure (2), dimensions 2063*806*390 mm.	100	Pcs.		

N.B.: Delivery time within which the material can be supplied:
_____ weeks.

Yours faithfully,

**Hisham Omari
Board Chairman and
Managing Director**

Figure.1. Small Pillar

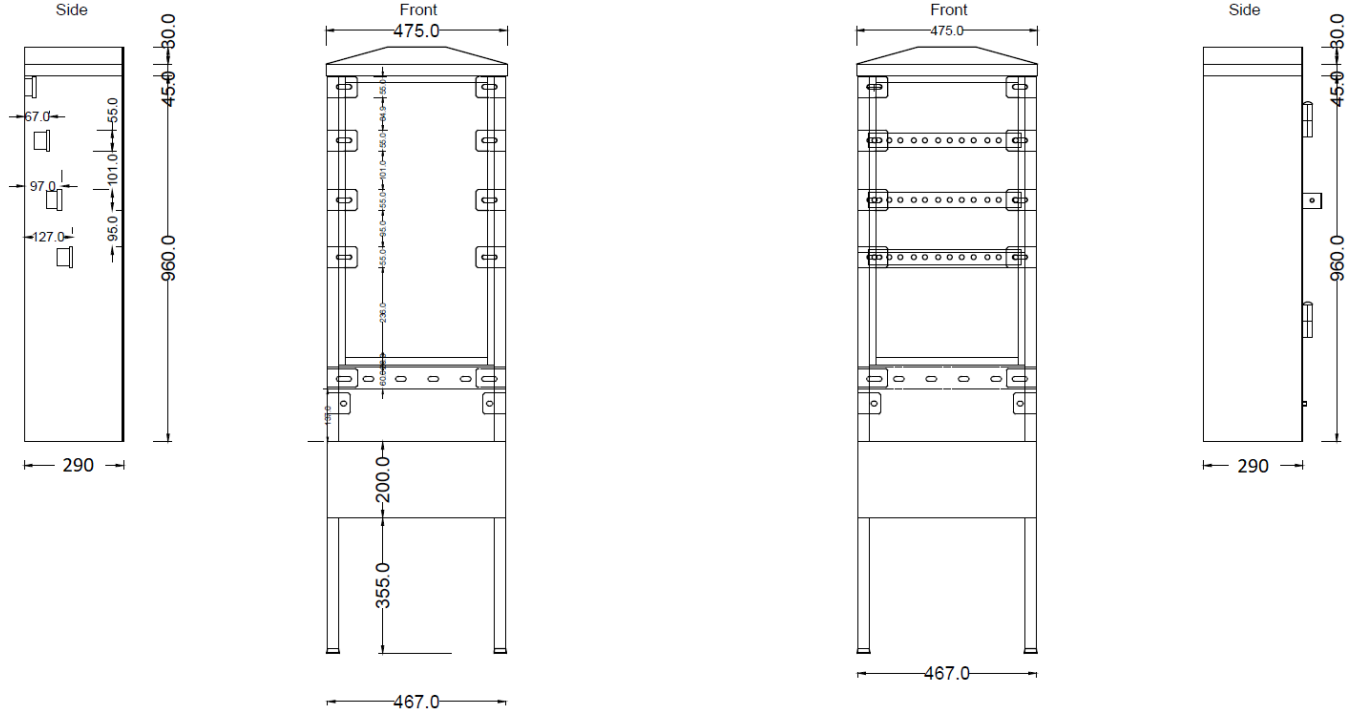


Figure.2. Medium Pillar

